



报告编号: 0915

测试时间: 2023-10-12 13:37

产品特征

灯具制造厂商:

灯具种类:

光源种类: 2700K

光源个数:

发光面长度(mm): 1000

发光面高度(mm): 65

电流: 0.446A

功率因数: 0.0000

灯具型号: C1000

光源型号:

光源光通量:

发光面宽度(mm): 1000

电压: 231 V

功率: 98.54 W

光度结果

灯具CIE分类: 直接型

灯具光通量: 12461.4 lm

下射光通量比: 99%

水平扩散角(50%): H102.6

垂直扩散角(50%): V102.3

灯具光效(lm/w): 126.46

峰值光强: 4701.44 cd

S/MH(C0/C180): 1.19

额定光通量: 12461.4 lm

灯具效率: 100%

上射光通量比: 1%

C0r0 光强: 4680.03 cd


峰值光强位置: H135 V0

S/MH(C90/C270): 1.19

灯具实物照片



配光曲线

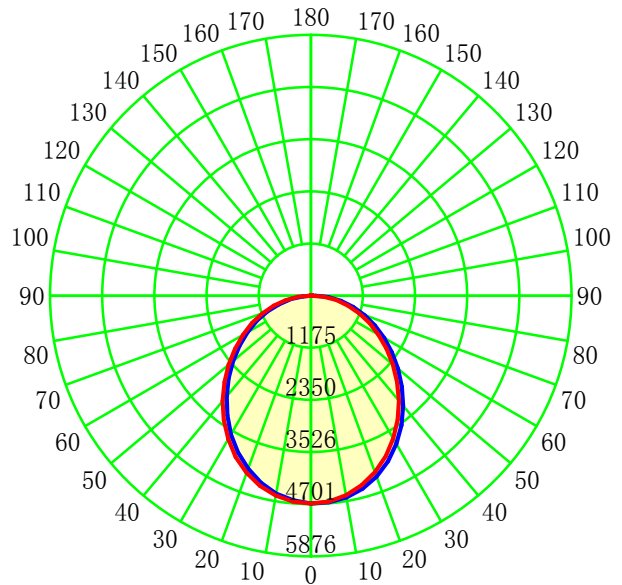

平均光束角(50%): 102.4°

— C0-C180

— C90-C270

C 平面 (°): 0.0-360.0: 45.0

测试单位:

测试类型: TYPE C

环境温度:

测试员:

Gamma 平面 (°): 0.0-180.0: 5.0

测试设备: GPM-1600L



测试距离: 7.600 m [K=1.0000]

环境湿度:

核 验:



配光曲线

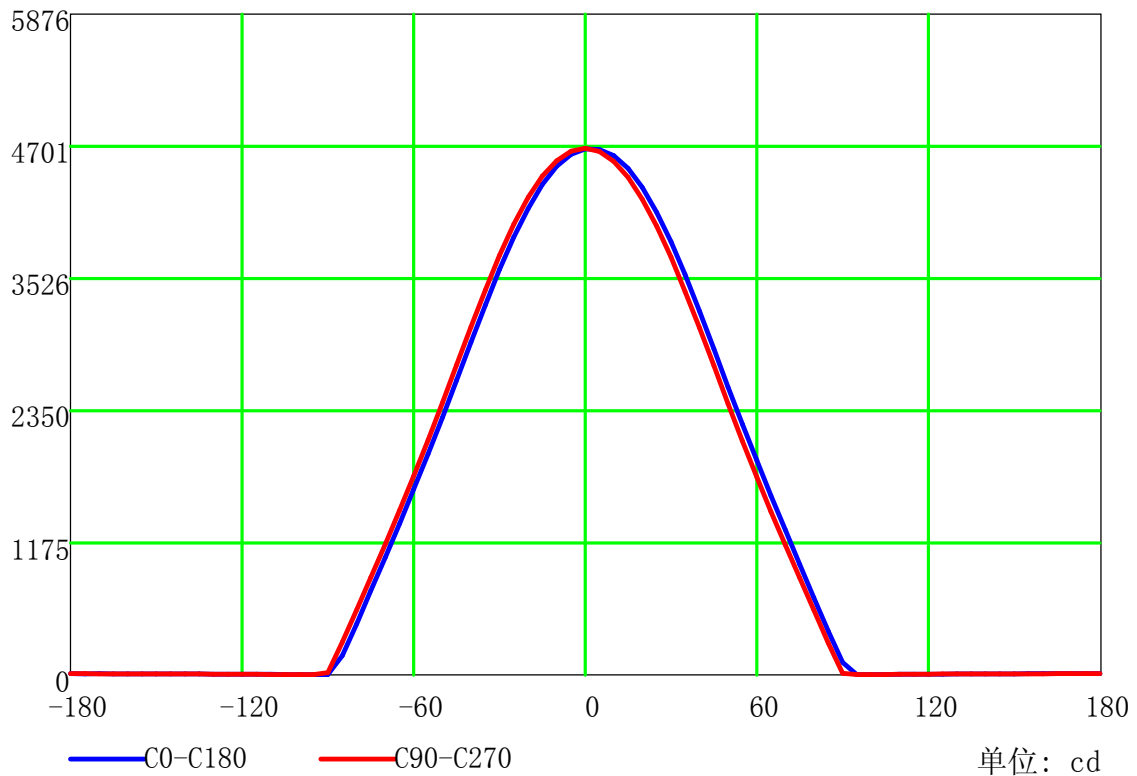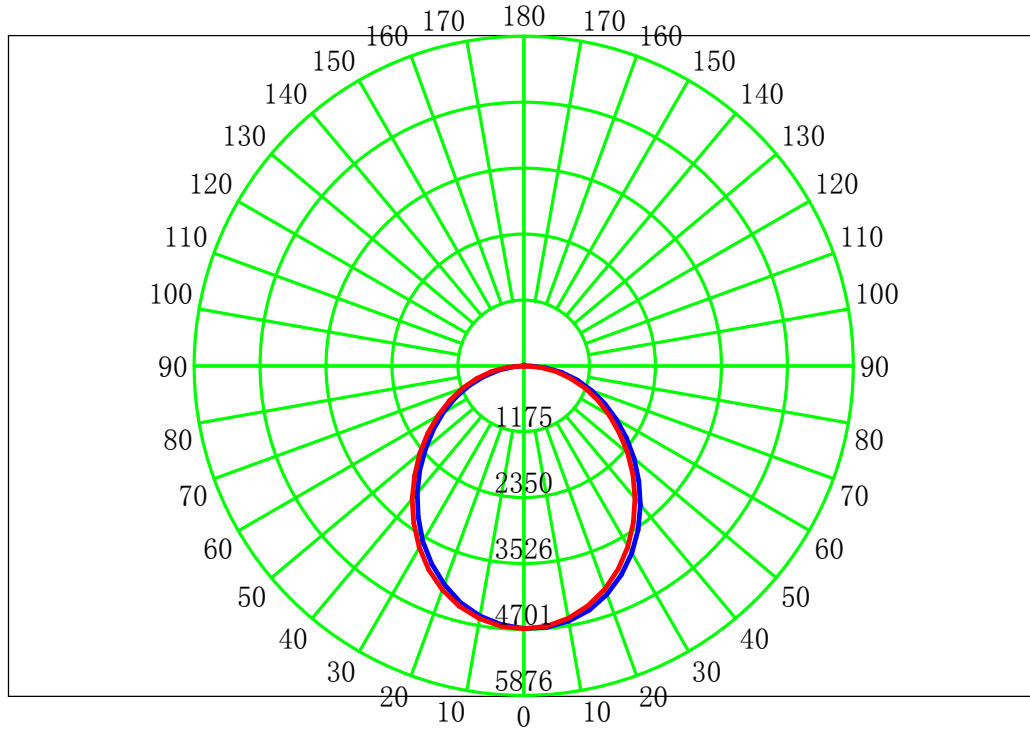

C 平面 (°): 0.0-360.0: 45.0

测试单位:

测试类型: TYPE C

环境温度:

测试员:

Gamma 平面 (°): 0.0-180.0: 5.0

测试设备: GPM-1600L

测试距离: 7.600 m [K=1.0000]

环境湿度:

核 验:



室内灯具利用系数表


RC	0.8	0.8	0.8	0.8	0.7	0.7	0.7	0.7	0.5	0.5	0.5	0.3	0.3	0.3	0.1	0.1	0.1	0
RW	0.7	0.5	0.3	0.1	0.7	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0
RCR	RF = 0.2																	
0	1.19	1.19	1.19	1.19	1.16	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	0.99
1	1.08	1.03	0.99	0.95	1.06	1.01	0.97	0.93	0.97	0.93	0.90	0.93	0.90	0.88	0.89	0.87	0.85	0.83
2	0.99	0.90	0.83	0.77	0.96	0.88	0.82	0.76	0.85	0.79	0.75	0.81	0.77	0.73	0.78	0.74	0.71	0.69
3	0.90	0.79	0.71	0.65	0.87	0.78	0.70	0.64	0.75	0.68	0.63	0.72	0.66	0.62	0.69	0.64	0.60	0.58
4	0.82	0.70	0.62	0.55	0.80	0.69	0.61	0.54	0.66	0.59	0.54	0.64	0.58	0.53	0.62	0.56	0.52	0.50
5	0.76	0.63	0.54	0.47	0.74	0.62	0.53	0.47	0.60	0.52	0.46	0.58	0.51	0.46	0.56	0.50	0.45	0.43
6	0.70	0.57	0.48	0.41	0.68	0.56	0.47	0.41	0.54	0.46	0.41	0.52	0.46	0.40	0.51	0.45	0.40	0.38
7	0.65	0.52	0.43	0.37	0.63	0.51	0.42	0.37	0.49	0.42	0.36	0.48	0.41	0.36	0.46	0.40	0.36	0.34
8	0.61	0.47	0.39	0.33	0.59	0.46	0.38	0.33	0.45	0.38	0.32	0.44	0.37	0.32	0.43	0.37	0.32	0.30
9	0.57	0.43	0.35	0.30	0.55	0.43	0.35	0.30	0.42	0.34	0.29	0.40	0.34	0.29	0.39	0.33	0.29	0.27
10	0.53	0.40	0.32	0.27	0.52	0.40	0.32	0.27	0.38	0.32	0.27	0.38	0.31	0.27	0.37	0.31	0.26	0.25

最大允许安装距离高度比(横向): 1.19

最大允许安装距离高度比(纵向): 1.19

最大允许安装距离高度比(对角): 1.30

灯具概算曲线

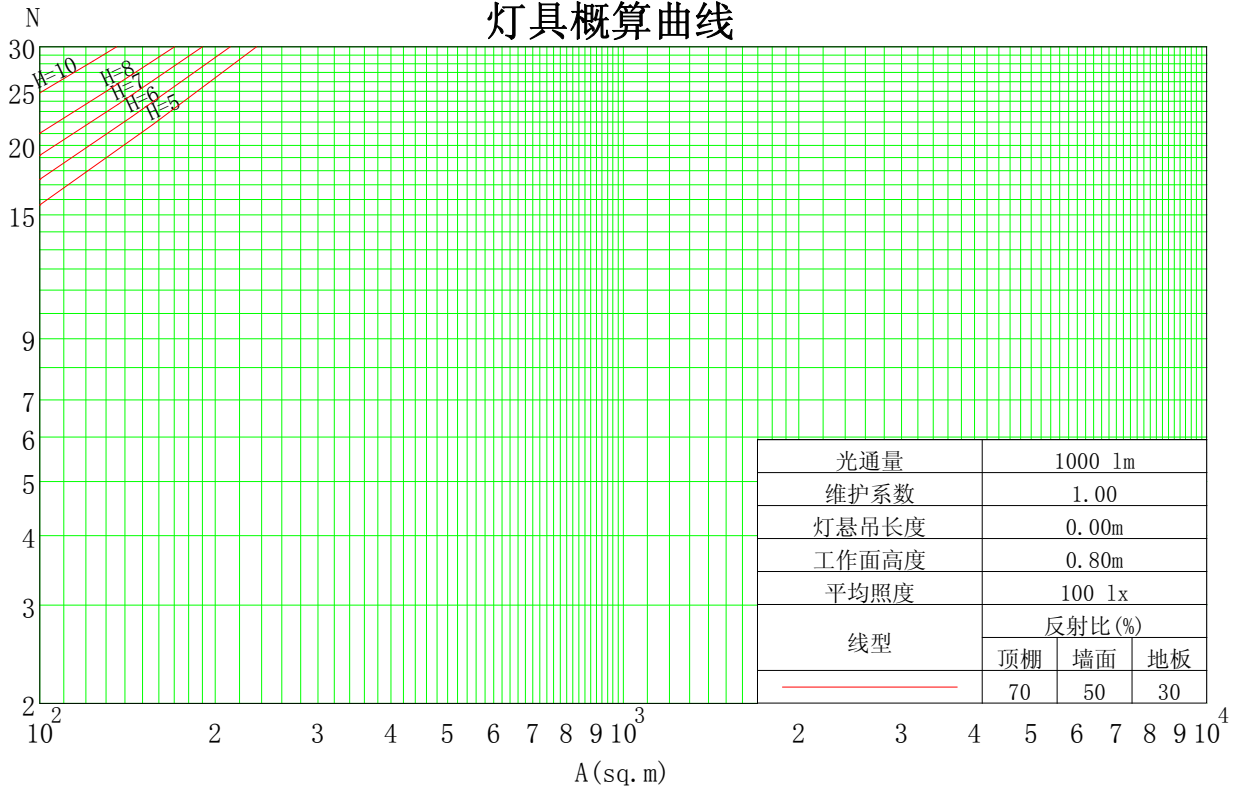

C 平面 (°):0.0-360.0: 45.0

测试单位:

测试类型: TYPE C

环境温度:

测试员:

Gamma 平面 (°):0.0-180.0:5.0

测试设备: GPM-1600L


测试距离: 7.600 m [K=1.0000]

环境湿度:

核 验:



灯具等光强图 (矩形)

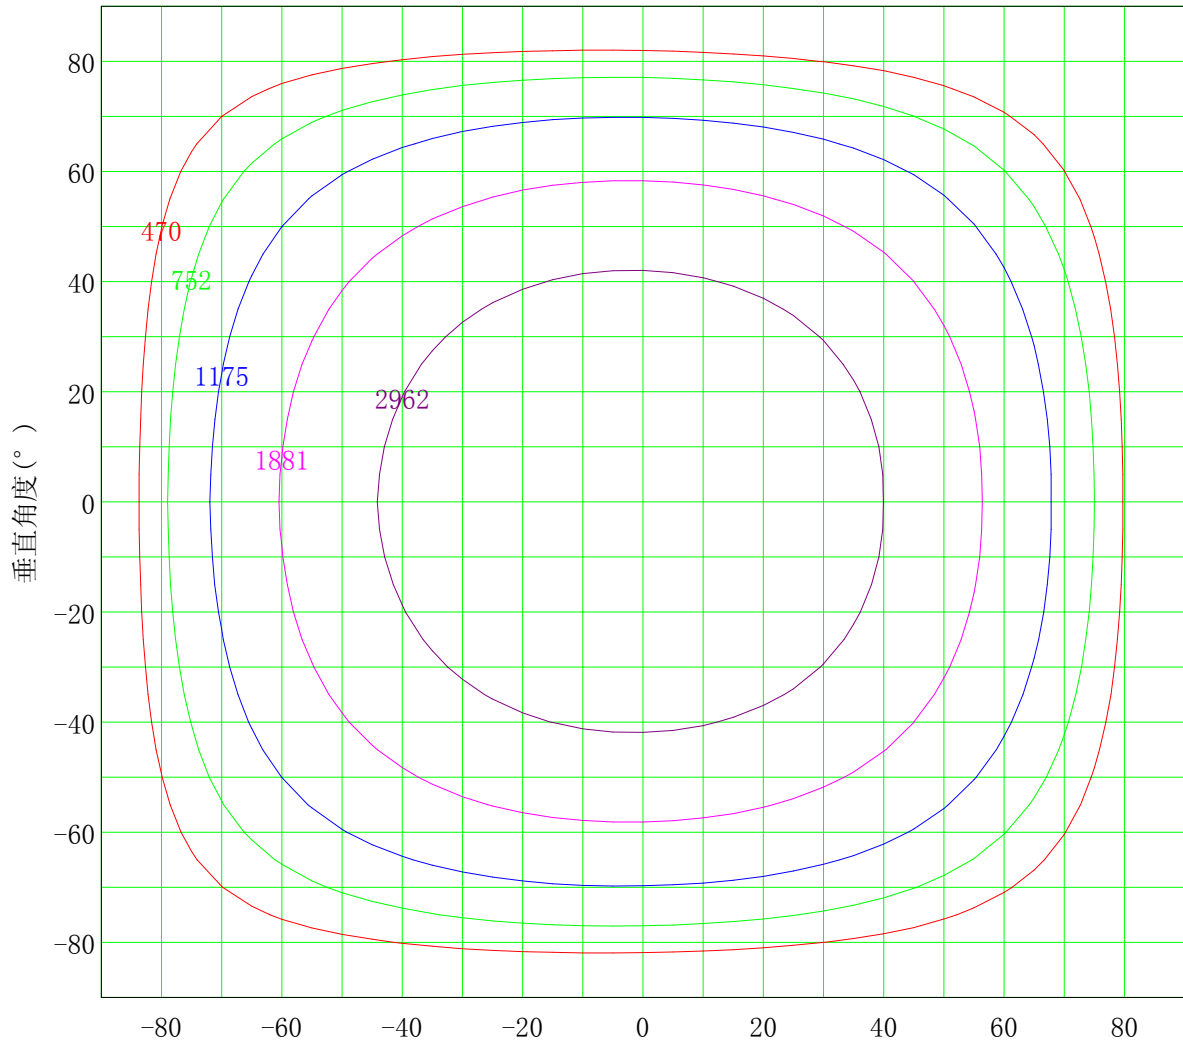

水平角度 (°)
Imax (100%): 4701 cd

(10%): 470 cd
(25%): 1175 cd
(63%): 2962 cd

(16%): 752 cd
(40%): 1881 cd
(100%): 4701 cd

C 平面 (°): 0.0-360.0: 45.0

测试单位:

测试类型: TYPE C

环境温度:

测试员:

Gamma 平面 (°): 0.0-180.0: 5.0

测试设备: GPM-1600L


测试距离: 7.600 m [K=1.0000]

环境湿度:

核 验:



水平面等照度曲线

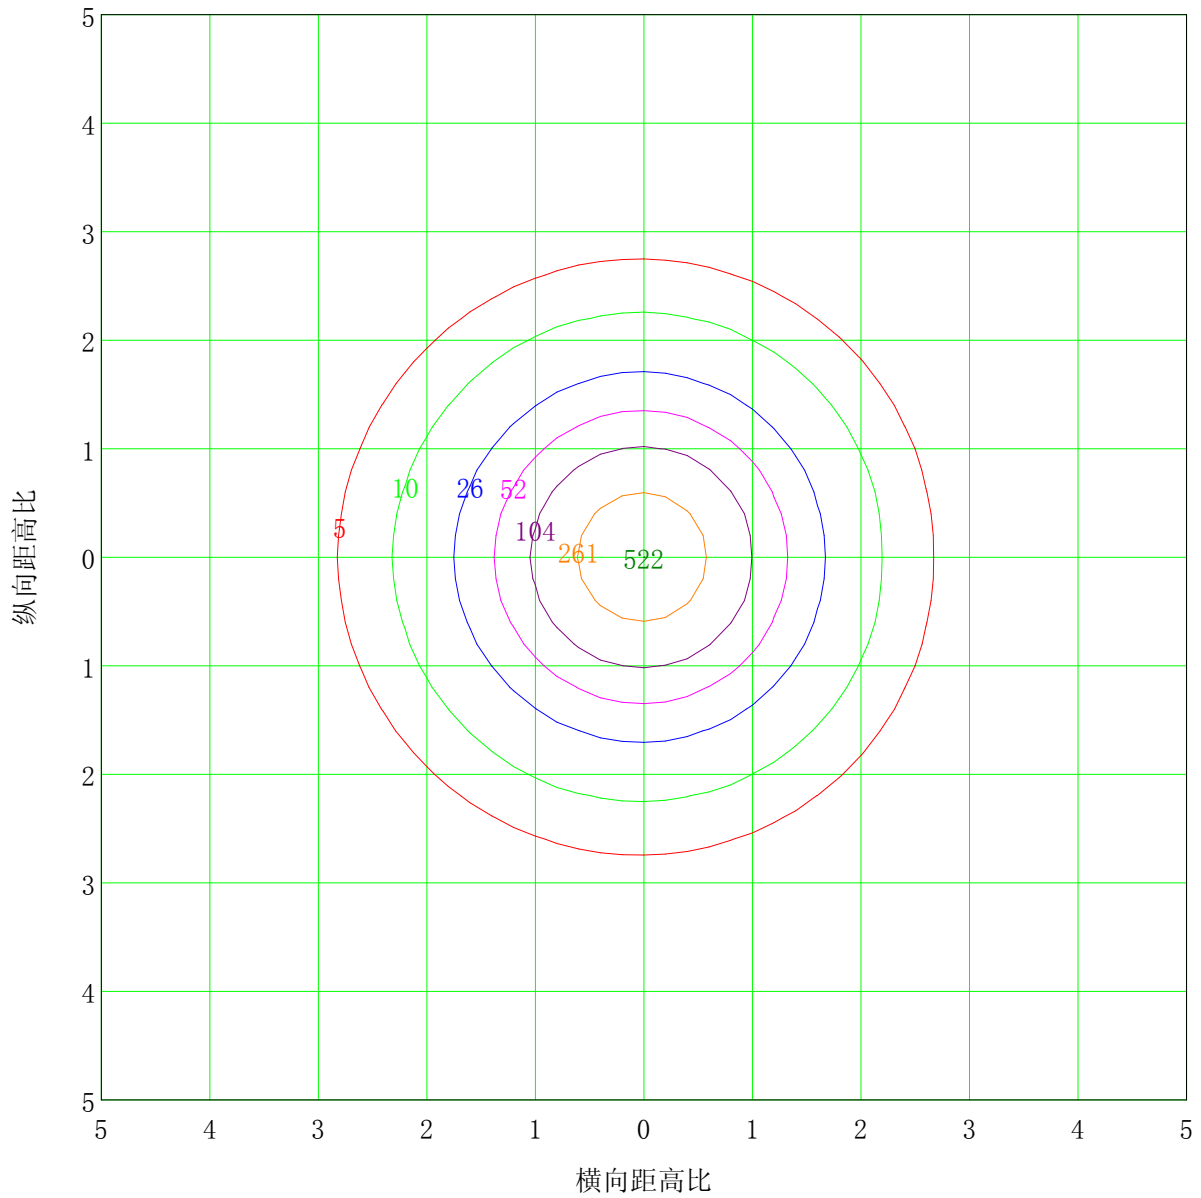

安装高度: 3.0m

最大照度值(100%): 522.4 lx

(1%): 5.2 lx

(2%): 10.4 lx

(5%): 26.1 lx

(10%): 52.2 lx

(20%): 104.5 lx

(50%): 261.2 lx

(100%): 522.4 lx

C 平面 (°):0.0-360.0: 45.0

Gamma 平面 (°):0.0-180.0:5.0

测试单位:

测试设备: GPM-1600L

测试类型: TYPE C

测试距离: 7.600 m [K=1.0000]

环境温度:

环境湿度:

测试员:



核 验:



亮度限制曲线

眩光评价价值	质量等级	使用照度 / lx							
1.15	A	2000	1000	500	≤300				
1.50	B		2000	1000	500	≤300			
1.85	C			2000	1000	500	≤300		
2.20	D				2000	1000	500	≤300	
2.55	E					2000	1000	500	≤300

a b c d e f g h

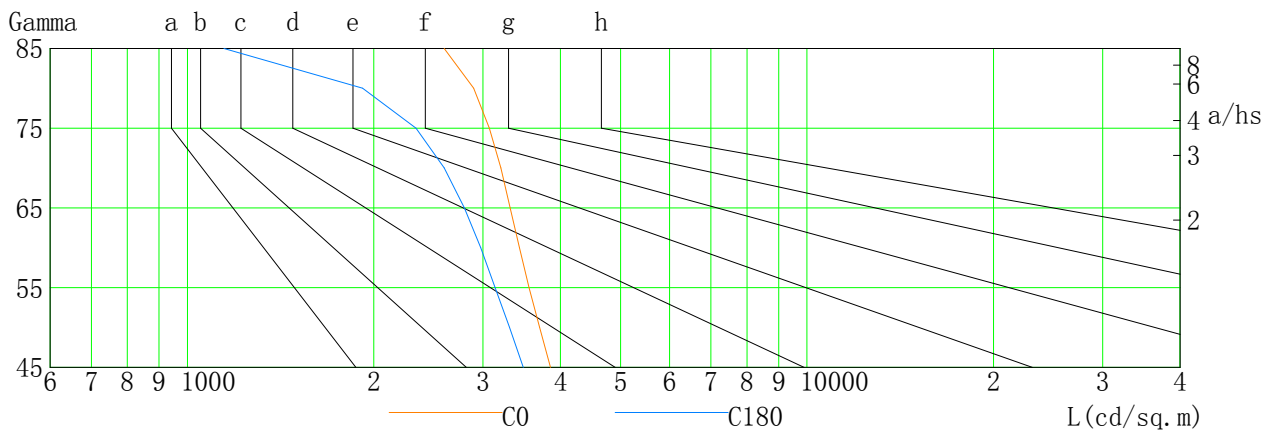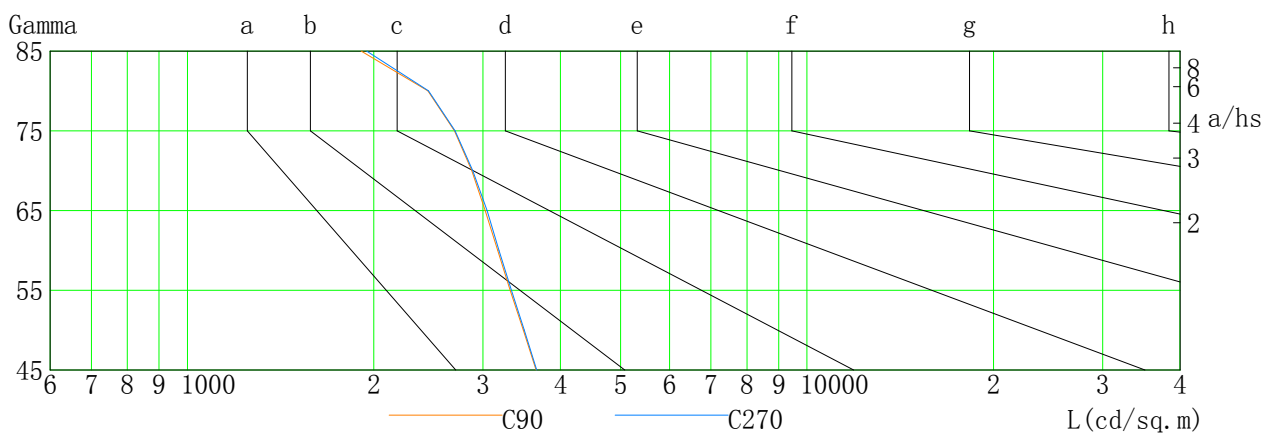

L (cd/sq. m)	G45	G50	G55	G60	G65	G70	G75	G80	G85
C0	3854	3701	3560	3433	3318	3207	3069	2898	2596
C90	3656	3485	3320	3168	3025	2878	2697	2445	1907
C180	3483	3308	3139	2974	2798	2597	2340	1917	1146
C270	3663	3498	3335	3183	3045	2885	2704	2450	1947

C 平面 (°):0.0-360.0: 45.0

测试单位:

测试类型: TYPE C

环境温度:

测试员:

Gamma 平面 (°):0.0-180.0:5.0

测试设备: GPM-1600L


测试距离: 7.600 m [K=1.0000]

环境湿度:

核 验:



照度距离关系图

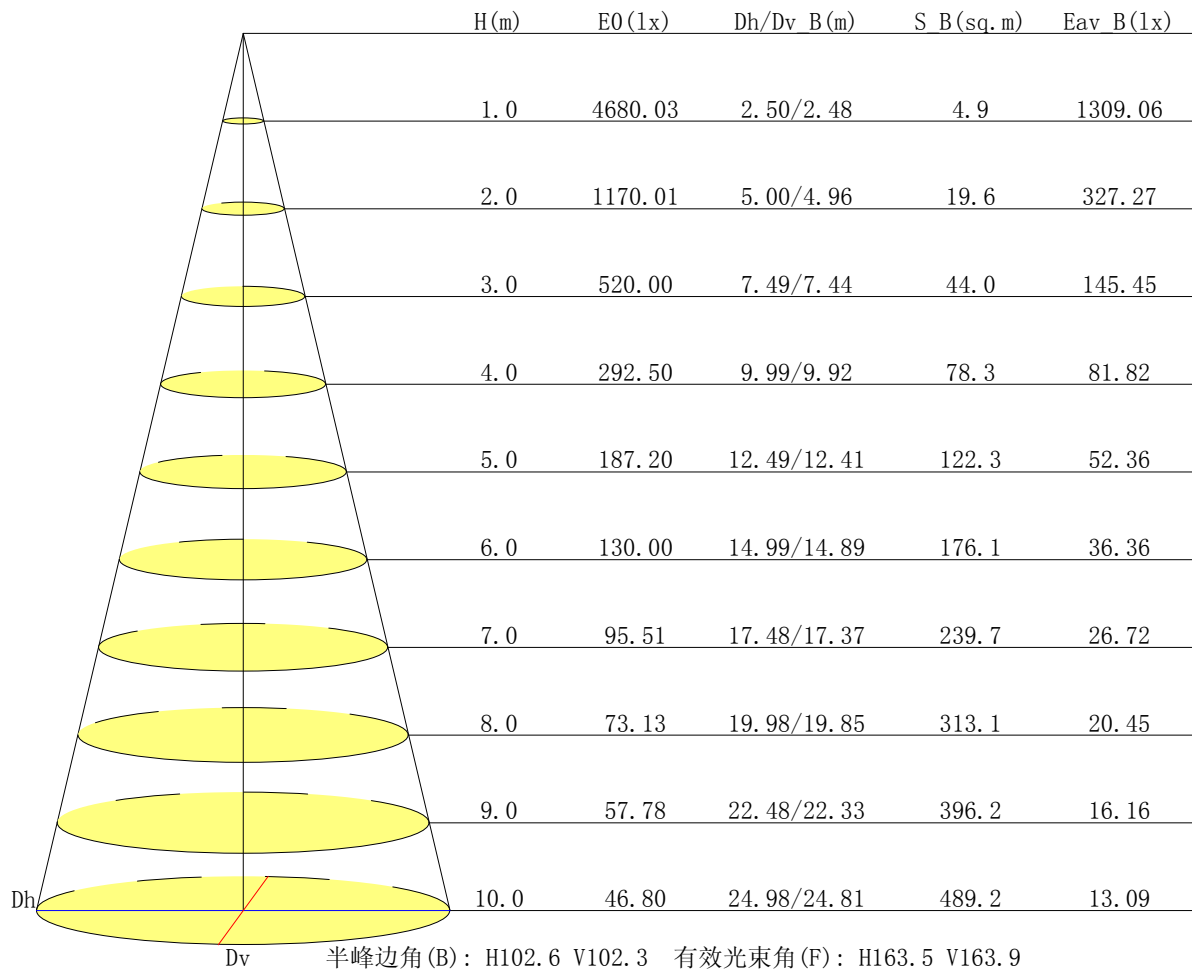


C 平面 (°):0.0-360.0: 45.0
测试单位:
测试类型: TYPE C
环境温度:
测试员:

Gamma 平面 (°):0.0-180.0:5.0
测试设备: GPM-1600L
测试距离: 7.600 m [K=1.0000]
环境湿度:
核 验:



垂直面等照度曲线

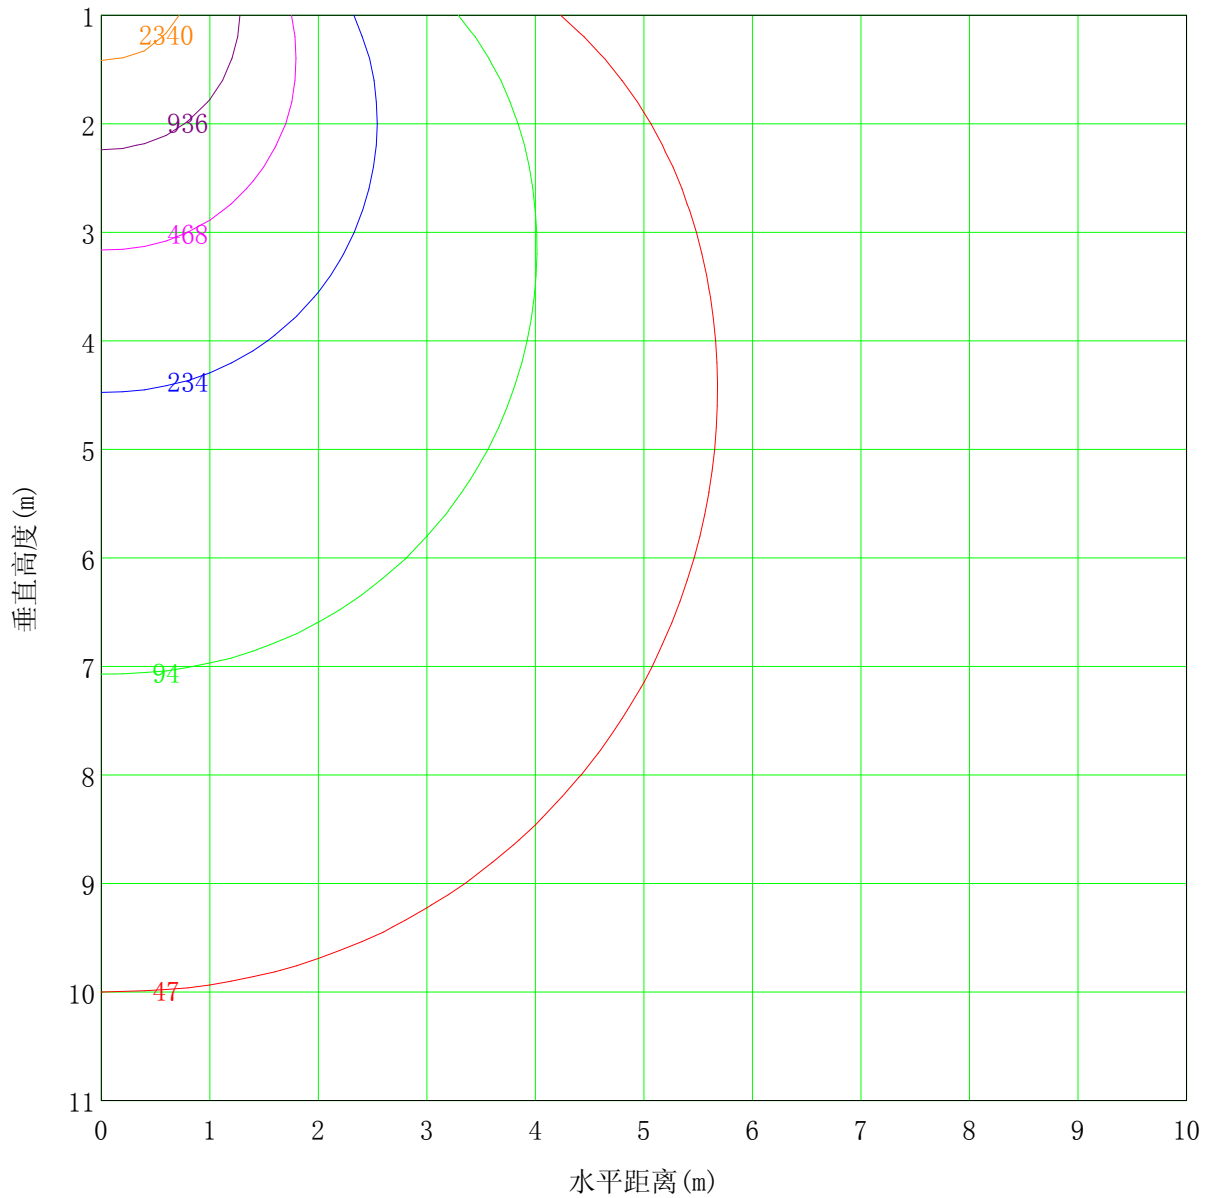

最低高度(米): 1.0m 最大高度(米): 11.0m 最大照度值: 4680.0 lx

— (1%): 46.8 lx

— (2%): 93.6 lx

— (5%): 234.0 lx

— (10%): 468.0 lx

— (20%): 936.0 lx

— (50%): 2340.0 lx

— (100%): 4680.0 lx

C 平面 (°): 0.0-360.0: 45.0

测试单位:

测试类型: TYPE C

环境温度:

测试员:

Gamma 平面 (°): 0.0-180.0: 5.0

测试设备: GPM-1600L

测试距离: 7.600 m [K=1.0000]

环境湿度:

核 验:



区域光通量表

单位: lm

纵向平面																					
单位: mm																					
-90	0.1	0.5	1.2	2.3	3.8	5.3	6.8	8.1	8.9	9.2	8.9	8.1	6.9	5.5	4.0	2.6	1.3	0.4	83.8	15.1	
-80	0.2	1.3	3.7	7.4	11.9	16.6	20.8	24.1	26.1	26.4	25.1	22.4	18.6	14.1	9.7	5.7	2.5	0.5	237.1	215.8	
-70	0.3	2.2	6.6	13.0	20.5	28.4	35.4	40.9	44.0	44.4	42.0	37.1	30.4	22.9	15.4	8.7	3.6	0.7	396.6	389.8	
-60	0.4	3.2	9.4	18.3	28.9	40.1	50.3	58.3	62.8	63.3	59.6	52.3	42.5	31.5	20.9	11.6	4.7	0.8	559.1	555.4	
-50	0.5	4.1	12.0	23.2	36.9	51.5	65.4	76.4	82.8	83.4	78.2	67.9	54.5	39.9	26.0	14.3	5.7	1.0	723.6	721.2	
-40	0.6	4.9	14.1	27.5	44.0	62.3	80.0	94.2	102.5	103.3	96.5	83.3	66.0	47.6	30.6	16.6	6.6	1.1	881.8	880.1	
-30	0.7	5.5	15.8	30.9	50.0	71.6	92.8	109.9	119.9	120.8	112.7	96.8	76.1	54.3	34.5	18.5	7.2	1.2	1019.2	1017.8	
-20	0.7	6.0	17.0	33.3	54.3	78.3	102.1	121.4	132.5	133.7	124.7	106.8	83.6	59.2	37.3	19.9	7.7	1.3	1120.0	1118.7	
-10	0.7	6.1	17.5	34.5	56.4	81.7	106.7	127.2	139.0	140.5	131.0	112.2	87.8	62.0	38.9	20.6	8.0	1.3	1172.3	1171.2	
0	0.7	6.2	17.5	34.5	56.4	81.7	106.8	127.4	139.3	140.0	130.6	112.0	87.7	62.0	38.9	20.7	8.0	1.3	1171.8	1170.8	
10	0.7	6.0	17.0	33.3	54.3	78.5	102.3	121.8	132.5	133.2	123.9	106.3	83.4	59.1	37.3	19.9	7.7	1.3	1118.6	1117.3	
20	0.7	5.6	15.8	30.9	50.0	71.7	93.0	110.0	119.6	120.3	112.0	96.2	75.7	54.1	34.5	18.5	7.2	1.2	1017.2	1015.8	
30	0.6	4.9	14.1	27.5	44.0	62.4	80.1	94.2	102.2	102.9	96.0	82.8	65.7	47.5	30.7	16.7	6.6	1.1	880.0	878.3	
40	0.5	4.2	12.0	23.2	36.9	51.5	65.3	76.3	82.6	83.1	77.8	67.6	54.3	39.9	26.1	14.3	5.7	1.0	722.4	720.1	
50	0.4	3.2	9.5	18.4	29.0	40.0	50.2	58.1	62.6	63.1	59.4	52.2	42.5	31.6	20.9	11.6	4.7	0.8	558.3	554.7	
60	0.3	2.2	6.7	13.1	20.6	28.4	35.4	40.8	43.8	44.2	41.9	37.1	30.5	22.9	15.4	8.7	3.6	0.7	396.4	389.5	
70	0.2	1.3	3.8	7.6	12.1	16.7	20.9	24.2	26.0	26.4	25.1	22.4	18.5	14.1	9.6	5.6	2.5	0.5	237.4	216.5	
80	0.1	0.5	1.2	2.4	3.9	5.4	6.8	8.0	8.8	9.0	8.8	8.0	6.8	5.4	4.0	2.6	1.3	0.4	83.3	14.8	
90	8.1	67.8	194.9	381.2	614.1	872.2	1121.3	1321.2	1436.0	1447.1	1135.4	3117.1	6931.6	673.8	434.6	237.2	94.8	16.6	12379		
Φ总	0.0	52.0	181.4	368.3	601.4	860.0	1109.1	1308.8	1424.6	1435.3	1342.8	1159.8	919.7	662.0	422.8	225.5	82.8	6.6		12163	
Φ有																					
-90	-80	-70	-60	-50	-40	-30	-20	-10	0	10	20	30	40	50	60	70	80	90	Φ总	Φ有	
横向平面																					

C 平面 (°): 0.0-360.0: 45.0

测试单位:

测试类型: TYPE C

环境温度:

测试员:

Gamma 平面 (°): 0.0-180.0: 5.0

测试设备: GPM-1600L


测试距离: 7.600 m [K=1.0000]

环境湿度:

核 验:



灯具有效平均照度图

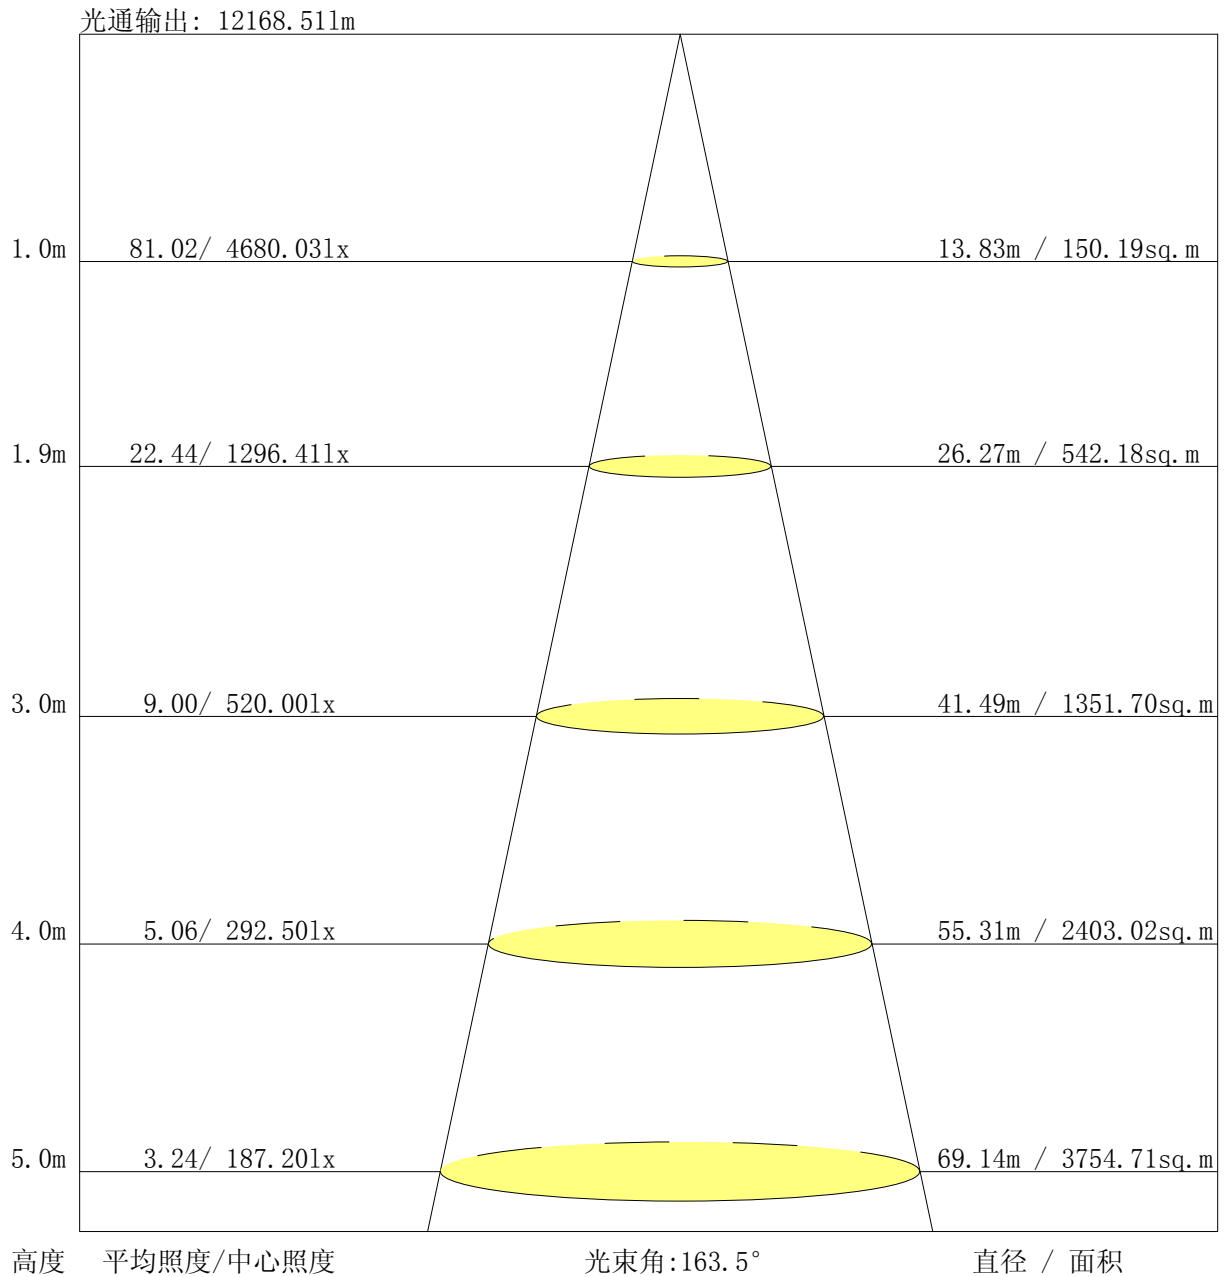

C 平面 (°): 0.0-360.0: 45.0
测试单位:
测试类型: TYPE C
环境温度:
测试员:

Gamma 平面 (°): 0.0-180.0: 5.0
测试设备: GPM-1600L
测试距离: 7.600 m [K=1.0000]
环境湿度:
核 验:



UGR 表

反射率:											
	天花板	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
	墙面	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
	工作面	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
房间尺寸		横向					纵向				
X=2H	Y=2H	16.9	18.3	17.2	18.5	18.8	16.6	18.0	16.9	18.2	18.5
	3H	18.5	19.8	18.9	20.1	20.4	18.2	19.4	18.5	19.7	20.0
	4H	19.3	20.5	19.6	20.8	21.1	18.8	20.0	19.2	20.3	20.6
	6H	19.9	21.0	20.3	21.3	21.6	19.4	20.5	19.7	20.8	21.1
	8H	20.1	21.2	20.5	21.5	21.9	19.5	20.6	19.9	20.9	21.3
	12H	20.3	21.3	20.7	21.7	22.0	19.7	20.7	20.1	21.0	21.4
X=4H	Y=2H	17.5	18.7	17.9	19.0	19.3	17.3	18.5	17.6	18.8	19.1
	3H	19.4	20.4	19.7	20.7	21.1	19.0	20.1	19.4	20.4	20.8
	4H	20.2	21.1	20.6	21.5	21.9	19.8	20.8	20.3	21.1	21.5
	6H	21.0	21.8	21.4	22.2	22.6	20.5	21.3	20.9	21.7	22.1
	8H	21.3	22.0	21.7	22.4	22.9	20.8	21.5	21.2	21.9	22.4
	12H	21.5	22.2	22.0	22.6	23.1	20.9	21.6	21.4	22.0	22.5
X=8H	Y=4H	20.5	21.3	21.0	21.7	22.1	20.2	20.9	20.6	21.3	21.8
	6H	21.4	22.0	21.9	22.5	23.0	21.0	21.6	21.5	22.1	22.5
	8H	21.8	22.4	22.3	22.8	23.3	21.4	21.9	21.8	22.4	22.9
	12H	22.2	22.7	22.7	23.1	23.7	21.6	22.1	22.1	22.6	23.1
X=12H	Y=4H	20.5	21.2	21.0	21.7	22.1	20.2	20.9	20.7	21.3	21.8
	6H	21.5	22.0	22.0	22.5	23.0	21.1	21.6	21.6	22.1	22.6
	8H	22.0	22.4	22.5	22.9	23.4	21.5	22.0	22.0	22.4	23.0
不同间距下随观察位置不同的变化量											
S=1.0H		+0.2/-0.2					+0.2/-0.2				
S=1.5H		+0.3/-0.4					+0.3/-0.5				
S=2.0H		+0.5/-0.8					+0.5/-0.8				

依据CIE Pub. 117计算, 表格已按12461lm光源光通量进行修正 ($81\log(F/F_0) = 8.8$).

C 平面 (°): 0.0-360.0: 45.0

测试单位:

测试类型: TYPE C

环境温度:

测试员:

Gamma 平面 (°): 0.0-180.0: 5.0

测试设备: GPM-1600L

测试距离: 7.600 m [K=1.0000]

环境湿度:

核 验:



利用系数表(地面)

利用系数 UF(F)			SHR NOM = 1.50								
房间反射率			室形指数 (RI)								
天花板	墙面	地面	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00
0.70	0.50	0.20	0.61	0.69	0.76	0.81	0.88	0.93	0.96	1.00	1.03
	0.30		0.54	0.62	0.69	0.74	0.82	0.87	0.91	0.96	1.00
	0.20		0.48	0.56	0.64	0.69	0.77	0.83	0.87	0.93	0.97
0.50	0.50	0.20	0.59	0.67	0.74	0.78	0.85	0.89	0.92	0.96	0.99
	0.30		0.53	0.60	0.68	0.73	0.80	0.85	0.88	0.93	0.96
	0.20		0.48	0.55	0.63	0.68	0.75	0.81	0.85	0.90	0.94
0.30	0.50	0.20	0.58	0.65	0.71	0.76	0.82	0.86	0.89	0.93	0.95
	0.30		0.52	0.59	0.66	0.71	0.78	0.82	0.85	0.90	0.93
	0.20		0.48	0.55	0.62	0.67	0.74	0.79	0.82	0.87	0.91
0.00	0.00	0.00	0.45	0.52	0.59	0.64	0.70	0.75	0.78	0.83	0.86
等级:99W 没有天花板的光度测定. 乘上利用系数的校正值 根据CIBSE TM5 1980标准计算											



利用系数表(墙面)

利用系数 UF(W)			SHR NOM = 1.50								
房间反射率			室形指数 (RI)								
天花板	墙面	地面	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00
0.70	0.50	0.20	0.93	0.79	0.67	0.59	0.47	0.39	0.34	0.26	0.22
	0.30		0.78	0.68	0.59	0.52	0.43	0.36	0.31	0.25	0.21
	0.20		0.67	0.59	0.52	0.47	0.39	0.33	0.29	0.23	0.20
0.50	0.50	0.20	0.90	0.76	0.64	0.56	0.45	0.41	0.32	0.25	0.20
	0.30		0.76	0.66	0.57	0.50	0.41	0.35	0.30	0.24	0.20
	0.20		0.66	0.58	0.51	0.46	0.38	0.32	0.28	0.23	0.19
0.30	0.50	0.20	0.87	0.73	0.62	0.54	0.43	0.36	0.31	0.24	0.20
	0.30		0.74	0.64	0.55	0.49	0.40	0.34	0.29	0.23	0.19
	0.20		0.65	0.57	0.50	0.45	0.37	0.31	0.27	0.22	0.18
0.00	0.00	0.00	0.54	0.47	0.41	0.36	0.29	0.25	0.21	0.17	0.14
等级:99W 没有天花板的光度测定. 乘上利用系数的校正值 根据CIBSE TM5 1980标准计算											



利用系数表(天花板)

利用系数 UF(C)			SHR NOM = 1.50								
房间反射率			室形指数 (RI)								
天花板	墙面	地面	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00
0.70	0.50	0.20	0.16	0.18	0.19	0.19	0.20	0.21	0.21	0.22	0.22
	0.30		0.10	0.12	0.13	0.14	0.16	0.17	0.18	0.19	0.20
	0.20		0.05	0.07	0.08	0.10	0.12	0.13	0.14	0.16	0.17
0.50	0.50	0.20	0.16	0.17	0.18	0.19	0.20	0.20	0.20	0.21	0.21
	0.30		0.10	0.11	0.13	0.14	0.15	0.16	0.17	0.18	0.19
	0.20		0.05	0.07	0.08	0.10	0.11	0.13	0.14	0.16	0.17
0.30	0.50	0.20	0.15	0.17	0.17	0.18	0.19	0.19	0.20	0.20	0.20
	0.30		0.09	0.11	0.12	0.13	0.15	0.16	0.17	0.18	0.18
	0.20		0.05	0.07	0.08	0.09	0.11	0.13	0.14	0.15	0.16
0.00	0.00	0.00	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01
等级:99W 没有天花板的光度测定. 乘上利用系数的校正值 根据CIBSE TM5 1980标准计算											

C 平面 (°):0.0-360.0: 45.0
测试单位:
测试类型: TYPE C
环境温度:
测试员:

Gamma 平面 (°):0.0-180.0:5.0
测试设备: GPM-1600L
测试距离: 7.600 m [K=1.0000]
环境湿度:
核 验:



灯具环带光通量

Gamma [°]	平均光强 [cd]	环带光通 [lm]	累积光通 [lm]	环带光通 [%]	累积光通 [%]
0.0-5.0	4673.0	111.7	111.7	0.90	0.90
5.0-10.0	4618.3	330.4	442.1	2.65	3.55
10.0-15.0	4507.8	534.8	977.0	4.29	7.84
15.0-20.0	4343.6	715.9	1692.9	5.75	13.59
20.0-25.0	4128.7	866.0	2558.9	6.95	20.53
25.0-30.0	3871.0	979.8	3538.7	7.86	28.40
30.0-35.0	3579.6	1054.2	4592.9	8.46	36.86
35.0-40.0	3262.5	1088.6	5681.6	8.74	45.59
40.0-45.0	2930.5	1085.2	6766.8	8.71	54.30
45.0-50.0	2593.7	1048.2	7815.0	8.41	62.71
50.0-55.0	2260.6	983.0	8798.0	7.89	70.60
55.0-60.0	1936.4	895.2	9693.2	7.18	77.79
60.0-65.0	1622.4	788.8	10482.0	6.33	84.12
65.0-70.0	1316.8	666.9	11148.9	5.35	89.47
70.0-75.0	1017.0	531.6	11680.5	4.27	93.73
75.0-80.0	721.8	386.3	12066.8	3.10	96.83
80.0-85.0	431.8	234.7	12301.4	1.88	98.72
85.0-90.0	162.6	89.1	12390.5	0.71	99.43
90.0-95.0	21.8	12.0	12402.4	0.10	99.53
95.0-100.0	6.7	3.6	12406.1	0.03	99.56
100.0-105.0	7.3	3.9	12410.0	0.03	99.59
105.0-110.0	8.1	4.2	12414.2	0.03	99.62
110.0-115.0	8.9	4.5	12418.7	0.04	99.66
115.0-120.0	9.6	4.7	12423.3	0.04	99.69
120.0-125.0	10.3	4.7	12428.1	0.04	99.73
125.0-130.0	10.8	4.7	12432.8	0.04	99.77
130.0-135.0	11.5	4.7	12437.5	0.04	99.81
135.0-140.0	12.1	4.5	12442.0	0.04	99.84
140.0-145.0	12.5	4.2	12446.1	0.03	99.88
145.0-150.0	12.9	3.8	12449.9	0.03	99.91
150.0-155.0	13.2	3.3	12453.3	0.03	99.93
155.0-160.0	13.5	2.8	12456.1	0.02	99.96
160.0-165.0	13.8	2.3	12458.4	0.02	99.98
165.0-170.0	14.1	1.7	12460.1	0.01	99.99
170.0-175.0	14.3	1.0	12461.1	0.01	100.00
175.0-180.0	14.5	0.3	12461.4	0.00	100.00

C 平面 (°):0.0-360.0: 45.0

测试单位:

测试类型: TYPE C

环境温度:

测试员:

Gamma 平面 (°):0.0-180.0:5.0

测试设备: GPM-1600L

测试距离: 7.600 m [K=1.0000]

环境湿度:

核 验:



灯具环带光通量 (续 1)

锥面光通量(90°): 6766.78 lm

%lum = 54.3%

%lamp = 54.3%

锥面光通量(120°): 9693.20 lm

%lum = 77.8%

%lamp = 77.8%

C 平面 ($^{\circ}$):0.0-360.0: 45.0

测试单位:

测试类型: TYPE C

环境温度:

测试员:

Gamma 平面 ($^{\circ}$):0.0-180.0:5.0

测试设备: GPM-1600L

测试距离: 7.600 m [K=1.0000]

环境湿度:

核 验:



光强分布数据表格

单位: cd

G\C	C0.0	C45.0	C90.0	C135.0	C180.0	C225.0	C270.0	C315.0	C360.0	
G0.0	4680.0	4677.8	4686.1	4701.4	4680.0	4677.8	4686.1	4701.4	4680.0	
G5.0	4674.0	4662.0	4656.4	4663.6	4632.1	4641.7	4659.6	4688.0	4674.0	
G10.0	4619.5	4588.9	4568.3	4569.2	4526.6	4548.0	4575.5	4619.0	4619.5	
G15.0	4507.0	4465.2	4425.5	4419.1	4365.2	4399.0	4437.2	4492.1	4507.0	
G20.0	4337.2	4281.3	4234.5	4217.7	4151.0	4200.4	4250.5	4314.0	4337.2	
G25.0	4115.7	4050.6	3993.6	3968.8	3896.3	3955.1	4011.2	4080.5	4115.7	
G30.0	3854.6	3782.5	3718.7	3686.6	3607.5	3673.3	3732.7	3809.1	3854.6	
G35.0	3560.8	3479.3	3410.2	3373.6	3291.0	3363.0	3425.3	3504.8	3560.8	
G40.0	3236.6	3154.4	3088.7	3043.7	2961.3	3034.1	3098.3	3174.3	3236.6	
G45.0	2902.1	2819.3	2752.9	2705.7	2622.7	2700.2	2758.6	2834.8	2902.1	
G50.0	2563.0	2481.1	2413.6	2367.9	2291.3	2367.5	2422.6	2495.1	2563.0	
G55.0	2231.2	2155.1	2080.9	2042.6	1967.3	2042.2	2090.7	2156.9	2231.2	
G60.0	1910.0	1834.5	1762.1	1725.0	1654.2	1725.0	1770.7	1834.7	1910.0	
G65.0	1597.8	1522.9	1456.5	1416.7	1347.3	1415.7	1466.3	1518.8	1597.8	
G70.0	1292.6	1218.4	1160.0	1118.7	1046.9	1115.2	1163.1	1212.7	1292.6	
G75.0	987.2	915.4	867.3	821.0	752.6	814.4	869.7	916.3	987.2	
G80.0	688.8	618.3	581.1	533.9	455.7	522.4	582.2	622.2	688.8	
G85.0	394.3	328.8	289.7	246.9	174.1	239.9	295.8	334.3	394.3	
G90.0	114.9	60.7	19.0	7.0	6.4	5.9	24.9	59.4	114.9	
G95.0	7.0	5.9	7.0	6.4	6.8	5.7	6.3	6.1	7.0	
G100.0	7.0	6.6	7.2	7.4	7.8	6.3	6.8	6.4	7.0	
G105.0	8.3	7.6	8.1	7.8	7.9	7.2	7.0	7.4	8.3	
G110.0	8.7	8.3	9.4	8.9	8.7	7.8	8.3	7.8	8.7	
G115.0	9.6	9.2	10.0	9.8	9.6	8.7	8.9	8.5	9.6	
G120.0	10.7	10.1	10.9	10.7	10.3	8.3	10.0	9.0	10.7	
G125.0	11.3	10.7	11.4	11.1	10.7	9.4	10.3	9.2	11.3	
G130.0	12.0	11.3	12.2	12.0	11.1	10.1	10.9	10.0	12.0	
G135.0	12.7	12.0	13.1	12.7	11.6	11.1	11.4	10.7	12.7	
G140.0	12.9	12.7	13.3	13.1	12.4	11.3	12.2	10.9	12.9	
G145.0	13.6	12.9	14.0	13.6	12.2	11.4	12.0	11.6	13.6	
G150.0	13.8	13.5	14.0	13.8	12.9	12.2	12.5	12.2	13.8	
G155.0	14.4	12.9	14.0	14.0	13.1	12.0	13.1	12.5	14.4	
G160.0	14.6	13.8	14.2	14.0	13.6	12.7	13.3	13.3	14.6	
G165.0	14.8	14.0	14.9	14.8	14.0	12.9	13.3	13.1	14.8	
G170.0	14.6	14.2	14.6	14.6	14.4	13.8	14.2	14.0	14.6	
G175.0	14.8	14.2	14.9	14.6	14.0	14.0	14.4	14.0	14.8	
G180.0	14.9	14.2	14.8	14.8	14.4	14.0	14.9	14.8	14.9	

C 平面 (°):0.0-360.0: 45.0

测试单位:

测试类型: TYPE C

环境温度:

测试员:

Gamma 平面 (°):0.0-180.0:5.0

测试设备: GPM-1600L

测试距离: 7.600 m [K=1.0000]

环境湿度:

核 验: